

Created by UK Facilities Information Services
Isolation Content: MPPD Personnel
Geospatial Requests@uky.edu
REV: 20150408


Isolation Rooms: 8

UK UNIVERSITY OF KENTUCKY
UK HealthCare | Negative Isolation Rooms
Chandler Medical Center (Pavilion H) [0293] Level [00]

ROOM NUM	DESIGNED EXHAUST	EXHAUST UNIT	DESIGNED SUPPLY	SUPPLY UNIT	NOTES
HA015	450	EF-2	245	AHU-1	ICU
HA017	420	EF-2	240	AHU-1	ICU
HA065	438	EF-2	378	AHU-2	A-II PSYCH ROOM
HA066	438	EF-2	378	AHU-2	A-II PSYCH ROOM
HA067	438	EF-2	378	AHU-1	A-II PSYCH ROOM
HA069	285	EF-2	225	AHU-2	A-II PSYCH ROOM
HA070	298	EF-2	238	AHU-1	A-II EXAM ROOM
HA071	276	EF-2	216	AHU-1	A-II EXAM ROOM
HA124	694	ON ROOF BESIDE ROOM	300	AHU-4A	ISOLATION-MICU
HA125	674	ON ROOF BESIDE ROOM	330	AHU-4A	ISOLATION-MICU

ROOM NUM	DESIGNED EXHAUST	EXHAUST UNIT	DESIGNED SUPPLY	SUPPLY UNIT	NOTES
HA225	300	F-21	125	ENDO-AHU	ISOLATION-RECOVERY
HA226	300	F-21	125	ENDO-AHU	ISOLATION-RECOVERY
H330E	191	EF-2	173	ENDO-AHU	ISO-ENDO
H330F	191	EF-2	173	ENDO-AHU	ISO-ENDO
H330G	191	EF-2	173	ENDO-AHU	ISO-ENDO
H330H	191	EF-2	173	ENDO-AHU	ISO-ENDO
H335	644	EF-2	584	ENDO-AHU	ISO-ENDO
H339	644	EF-2	584	ENDO-AHU	ISO-ENDO
H531	240	EF-2	40	H-6	ISO-TB
H532	250	EF-2	40	H-6	ISO-TB

ROOM NUM	DESIGNED EXHAUST	EXHAUST UNIT	DESIGNED SUPPLY	SUPPLY UNIT	NOTES
H533	240	EF-2	40	H-6	ISO-TB
H534	250	EF-2	40	H-6	ISO-TB
H535	225	EF-2	60	H-6	ISO-TB
H536	240	EF-2	40	H-6	ISO-TB
H537	225	EF-2	40	H-6	ISO-TB
H539	250	EF-2	40	H-6	ISO-TB
H540	250	EF-2	40	H-6	ISO-TB
H542	250	EF-2	40	H-6	ISO-TB
H642	210	EF-2	190	H-6	ISOLATION

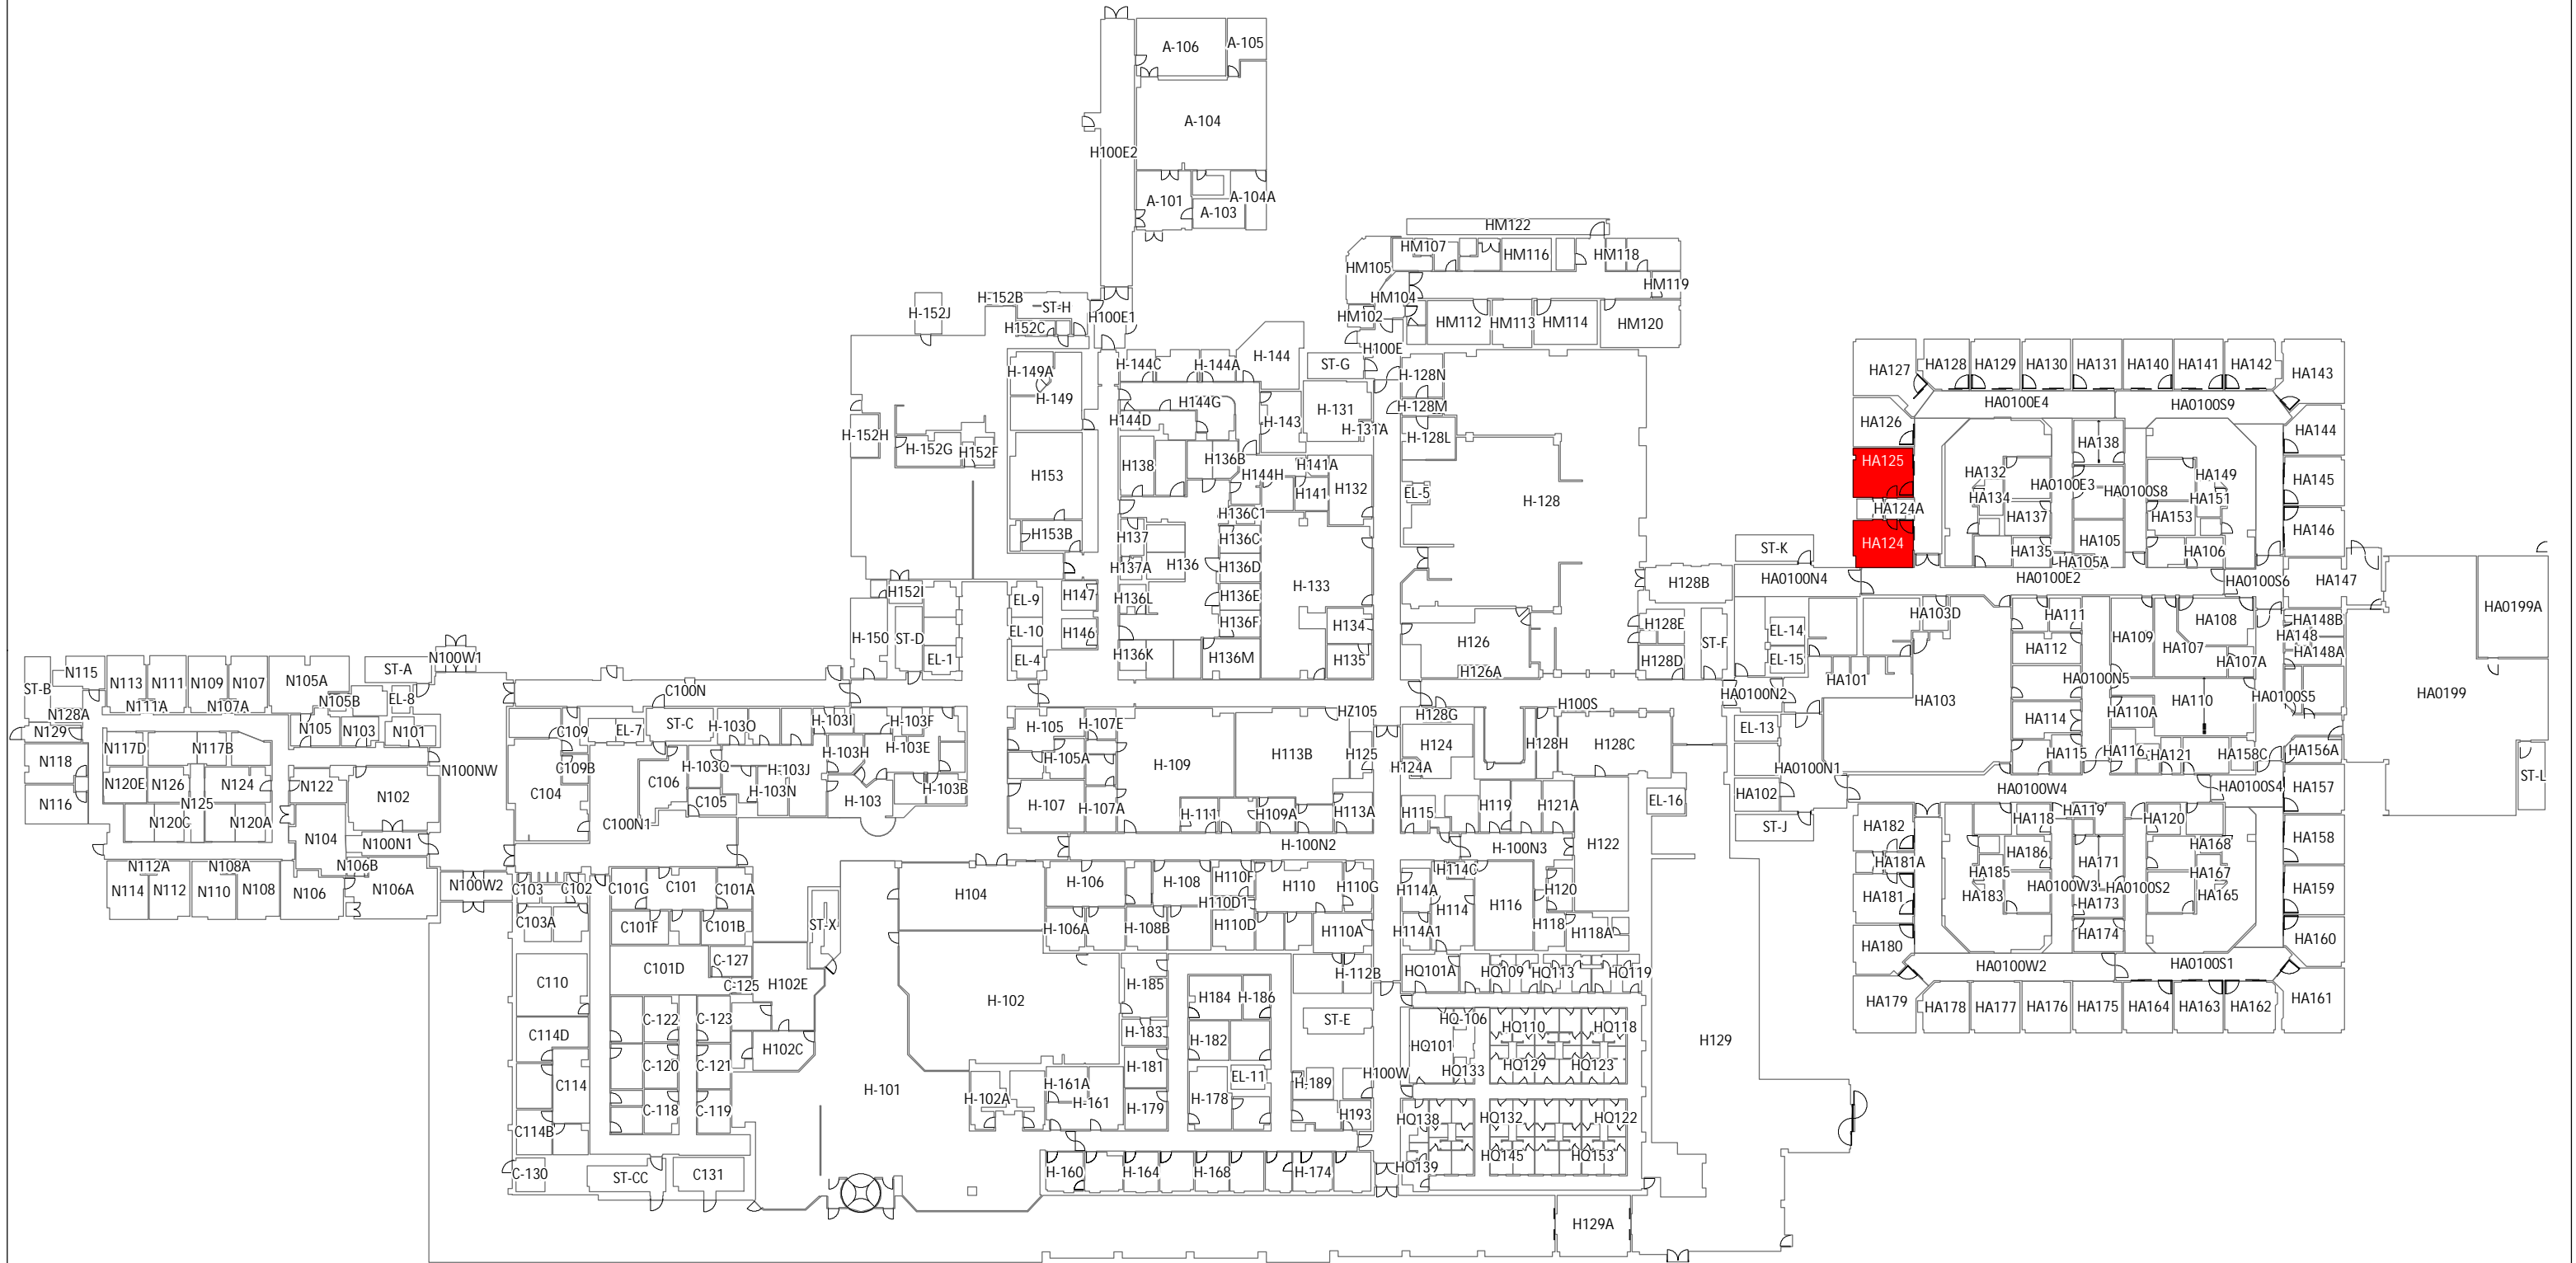


Created by UK Facilities Information Services
 Isolation Content: MPPD Personnel
 Geospatial Requests@uky.edu
 REV: 20150408

Isolation Rooms: 2

UK UNIVERSITY OF KENTUCKY
 UK HealthCare | Negative Isolation Rooms
 Chandler Medical Center (Pavilion H) [0293] Level [01]

ROOM NUM	DESIGNED EXHAUST	EXHAUST UNIT	DESIGNED SUPPLY	SUPPLY UNIT	NOTES	ROOM NUM	DESIGNED EXHAUST	EXHAUST UNIT	DESIGNED SUPPLY	SUPPLY UNIT	NOTES	ROOM NUM	DESIGNED EXHAUST	EXHAUST UNIT	DESIGNED SUPPLY	SUPPLY UNIT	NOTES
HA015	450	EF-2	245	AHU-1	ICU	HA225	300	F-21	125	ENDO-AHU	ISOLATION-RECOVERY	H533	240	EF-2	40	H-6	ISO-TB
HA017	420	EF-2	240	AHU-1	ICU	HA226	300	F-21	125	ENDO-AHU	ISOLATION-RECOVERY	H534	250	EF-2	40	H-6	ISO-TB
HA065	438	EF-2	378	AHU-2	A-II PSYCH ROOM	H330E	191	EF-2	173	ENDO-AHU	ISO-ENDO	H535	225	EF-2	60	H-6	ISO-TB
HA066	438	EF-2	378	AHU-2	A-II PSYCH ROOM	H330F	191	EF-2	173	ENDO-AHU	ISO-ENDO	H536	240	EF-2	40	H-6	ISO-TB
HA067	438	EF-2	378	AHU-1	A-II PSYCH ROOM	H330G	191	EF-2	173	ENDO-AHU	ISO-ENDO	H537	225	EF-2	40	H-6	ISO-TB
HA069	285	EF-2	225	AHU-2	A-II PSYCH ROOM	H330H	191	EF-2	173	ENDO-AHU	ISO-ENDO	H539	250	EF-2	40	H-6	ISO-TB
HA070	298	EF-2	238	AHU-1	A-II EXAM ROOM	H335	644	EF-2	584	ENDO-AHU	ISO-ENDO	H540	250	EF-2	40	H-6	ISO-TB
HA071	276	EF-2	216	AHU-1	A-II EXAM ROOM	H339	644	EF-2	584	ENDO-AHU	ISO-ENDO	H542	250	EF-2	40	H-6	ISO-TB
HA124	694	ON ROOF BESIDE ROOM	300	AHU-4A	ISOLATION-MICU	H531	240	EF-2	40	H-6	ISO-TB	H642	210	EF-2	190	H-6	ISOLATION
HA125	674	ON ROOF BESIDE ROOM	330	AHU-4A	ISOLATION-MICU	H532	250	EF-2	40	H-6	ISO-TB						

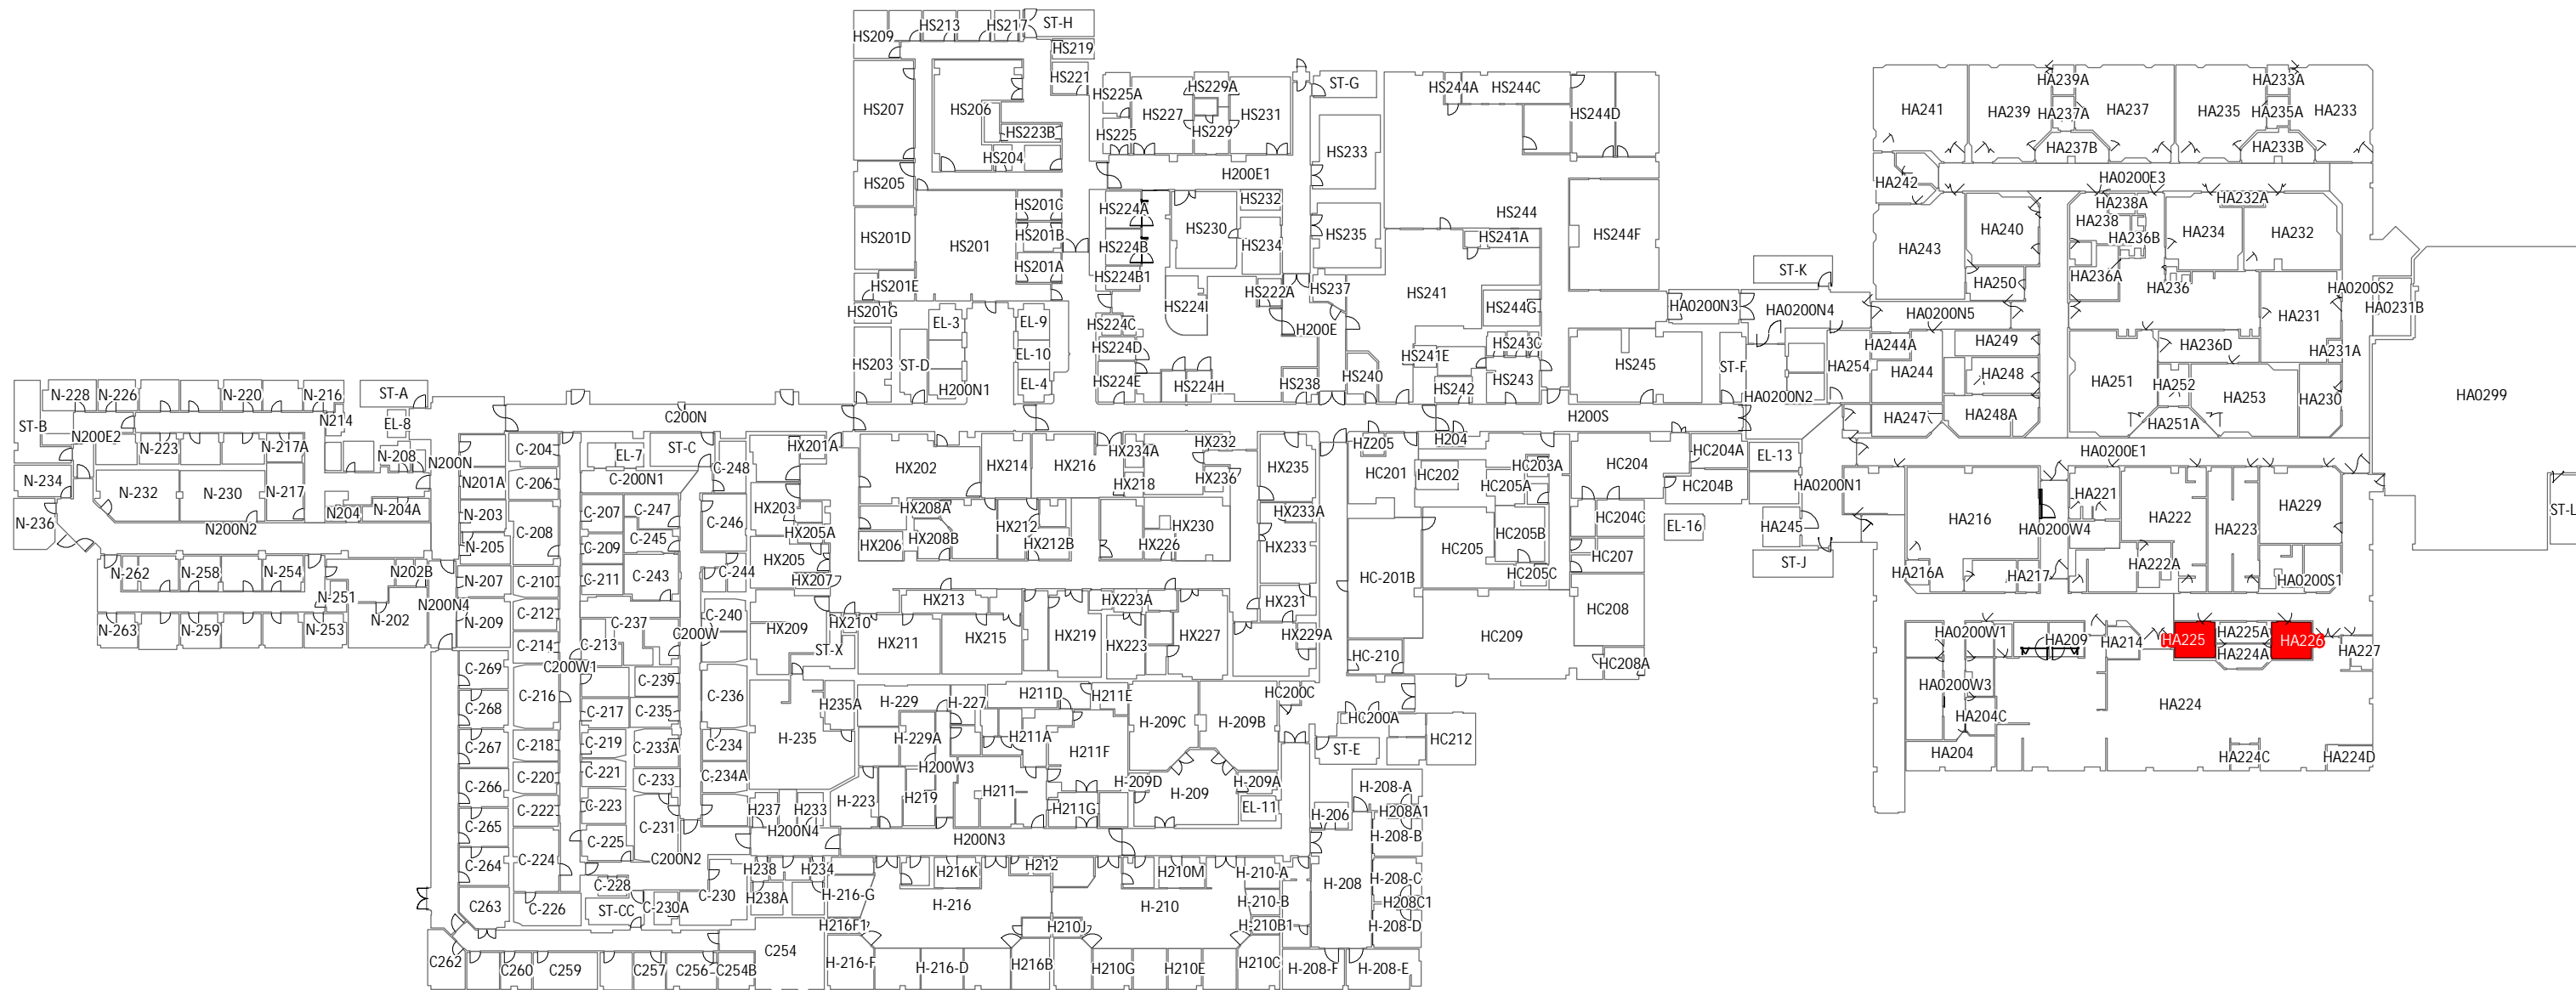

Created by UK Facilities Information Services
 Isolation Content: MPPD Personnel
 Geospatial/Requests@uky.edu
 REV: 20150408


Isolation Rooms: 2

UK UNIVERSITY OF KENTUCKY
 UK HealthCare | Negative Isolation Rooms
 Chandler Medical Center (Pavilion H) [0293] Level [02]

ROOM NUM	DESIGNED EXHAUST	EXHAUST UNIT	DESIGNED SUPPLY	SUPPLY UNIT	NOTES
HA015	450	EF-2	245	AHU-1	ICU
HA017	420	EF-2	240	AHU-1	ICU
HA065	438	EF-2	378	AHU-2	A-II PSYCH ROOM
HA066	438	EF-2	378	AHU-2	A-II PSYCH ROOM
HA067	438	EF-2	378	AHU-1	A-II PSYCH ROOM
HA069	285	EF-2	225	AHU-2	A-II PSYCH ROOM
HA070	298	EF-2	238	AHU-1	A-II EXAM ROOM
HA071	276	EF-2	216	AHU-1	A-II EXAM ROOM
HA124	694	ON ROOF BESIDE ROOM	300	AHU-4A	ISOLATION-MICU
HA125	674	ON ROOF BESIDE ROOM	330	AHU-4A	ISOLATION-MICU

ROOM NUM	DESIGNED EXHAUST	EXHAUST UNIT	DESIGNED SUPPLY	SUPPLY UNIT	NOTES
HA225	300	F-21	125	ENDO-AHU	ISOLATION-RECOVERY
HA226	300	F-21	125	ENDO-AHU	ISOLATION-RECOVERY
H330E	191	EF-2	173	ENDO-AHU	ISO-ENDO
H330F	191	EF-2	173	ENDO-AHU	ISO-ENDO
H330G	191	EF-2	173	ENDO-AHU	ISO-ENDO
H330H	191	EF-2	173	ENDO-AHU	ISO-ENDO
H335	644	EF-2	584	ENDO-AHU	ISO-ENDO
H339	644	EF-2	584	ENDO-AHU	ISO-ENDO
HS31	240	EF-2	40	H-6	ISO-TB
HS32	250	EF-2	40	H-6	ISO-TB

ROOM NUM	DESIGNED EXHAUST	EXHAUST UNIT	DESIGNED SUPPLY	SUPPLY UNIT	NOTES
HS33	240	EF-2	40	H-6	ISO-TB
HS34	250	EF-2	40	H-6	ISO-TB
HS35	225	EF-2	60	H-6	ISO-TB
HS36	240	EF-2	40	H-6	ISO-TB
HS37	225	EF-2	40	H-6	ISO-TB
HS39	250	EF-2	40	H-6	ISO-TB
HS40	250	EF-2	40	H-6	ISO-TB
HS42	250	EF-2	40	H-6	ISO-TB
H642	210	EF-2	190	H-6	ISOLATION

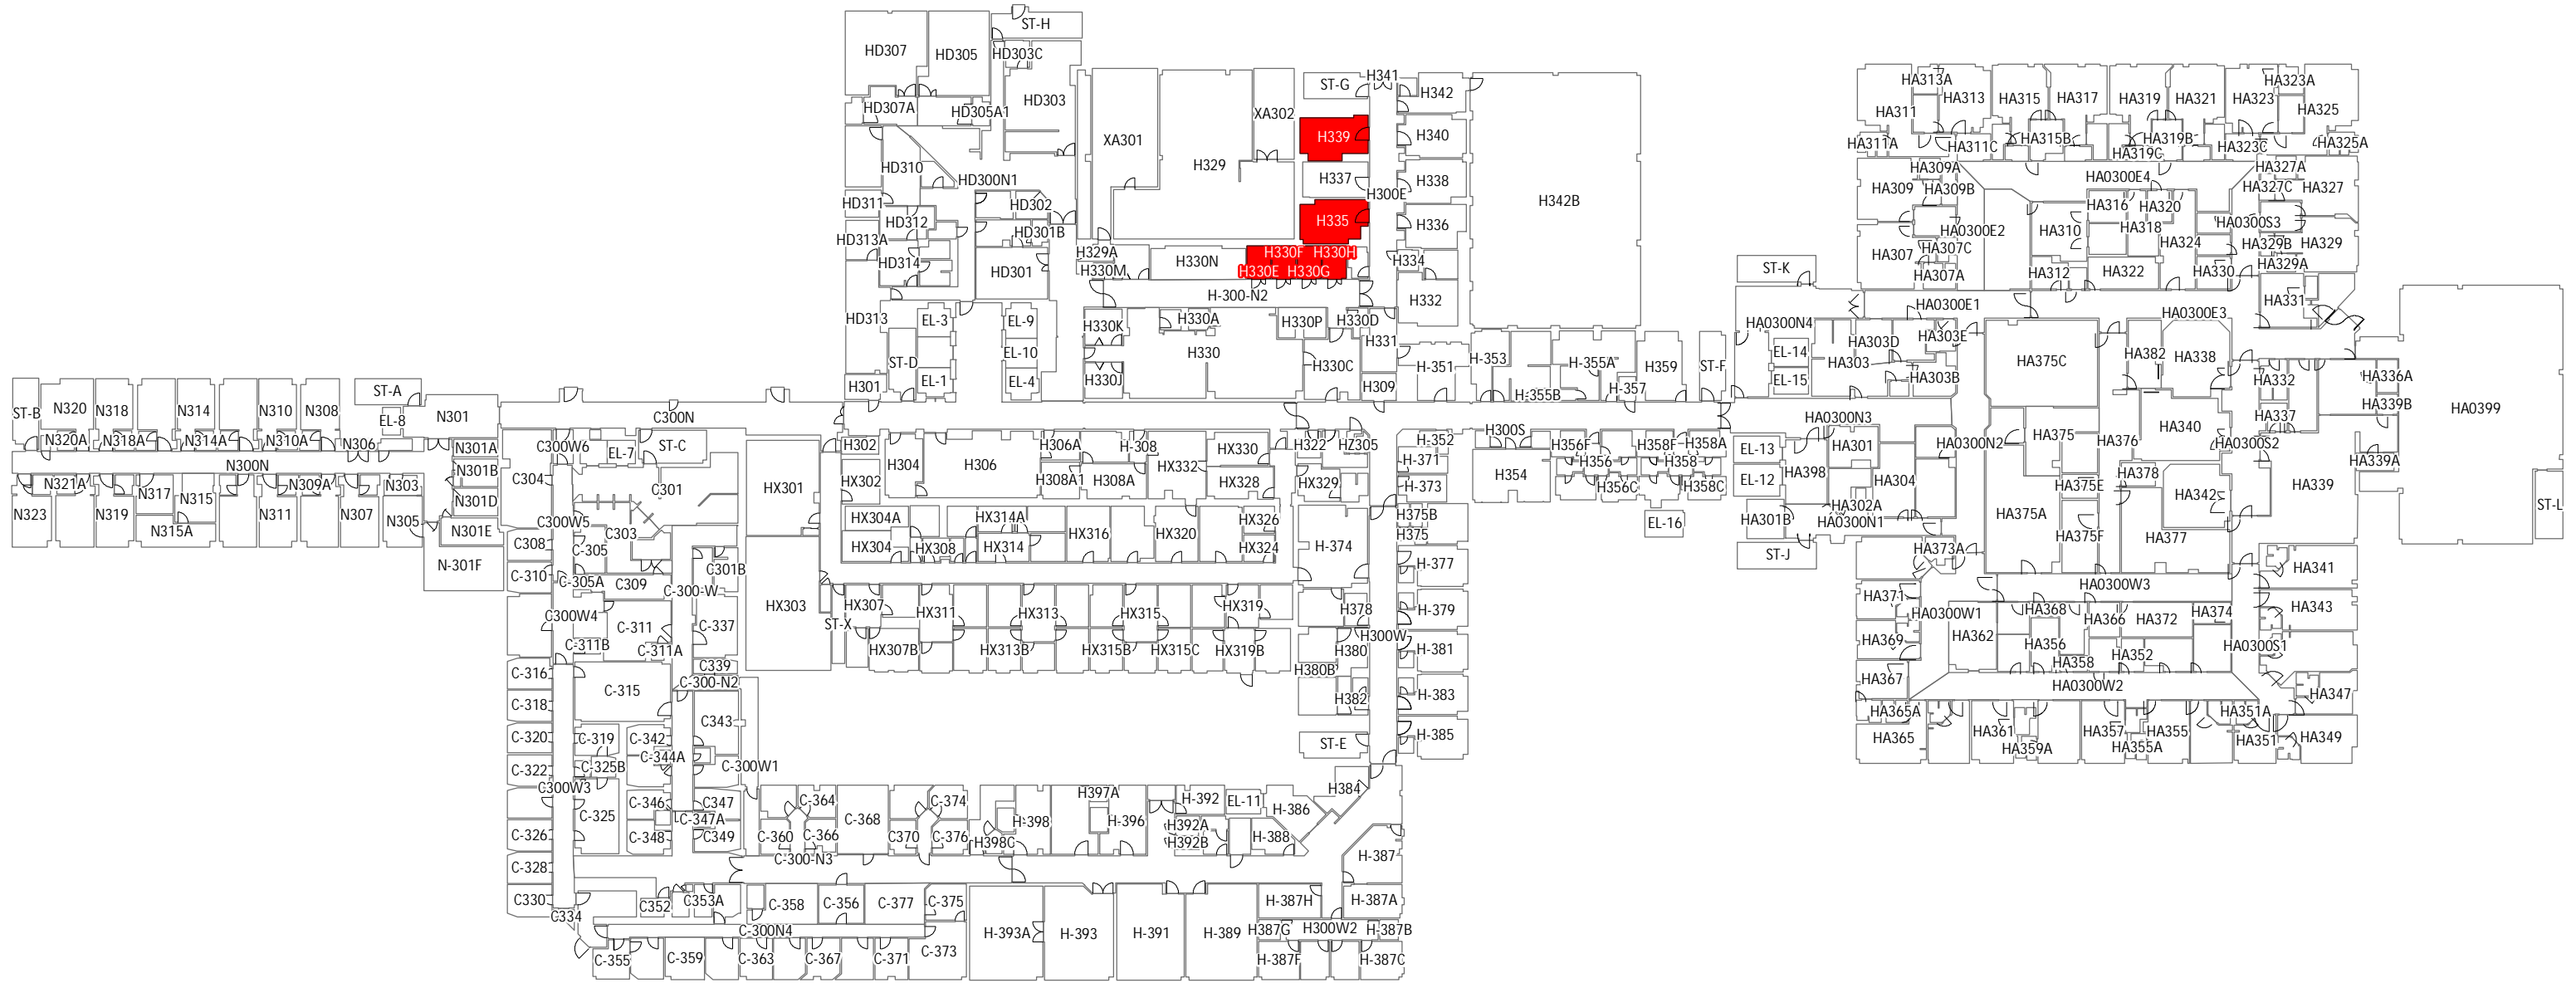

Created by UK Facilities Information Services
 Isolation Content: MPPD Personnel
 Geospatial/Requests@uky.edu
 REV: 20150408

Isolation Rooms: 6

UK UNIVERSITY OF KENTUCKY
 UK HealthCare | Negative Isolation Rooms
 Chandler Medical Center (Pavilion H) [0293] Level [03]

ROOM NUM	DESIGNED EXHAUST	EXHAUST UNIT	DESIGNED SUPPLY	SUPPLY UNIT	NOTES
HA015	450	EF-2	245	AHU-1	ICU
HA017	420	EF-2	240	AHU-1	ICU
HA065	438	EF-2	378	AHU-2	A-II PSYCH ROOM
HA066	438	EF-2	378	AHU-2	A-II PSYCH ROOM
HA067	438	EF-2	378	AHU-1	A-II PSYCH ROOM
HA069	285	EF-2	225	AHU-2	A-II PSYCH ROOM
HA070	298	EF-2	238	AHU-1	A-II EXAM ROOM
HA071	276	EF-2	216	AHU-1	A-II EXAM ROOM
HA124	694	ON ROOF BESIDE ROOM	300	AHU-4A	ISOLATION-MICU
HA125	674	ON ROOF BESIDE ROOM	330	AHU-4A	ISOLATION-MICU

ROOM NUM	DESIGNED EXHAUST	EXHAUST UNIT	DESIGNED SUPPLY	SUPPLY UNIT	NOTES
HA225	300	F-21	125	ENDO-AHU	ISOLATION-RECOVERY
HA226	300	F-21	125	ENDO-AHU	ISOLATION-RECOVERY
H330E	191	EF-2	173	ENDO-AHU	ISO-ENDO
H330F	191	EF-2	173	ENDO-AHU	ISO-ENDO
H330G	191	EF-2	173	ENDO-AHU	ISO-ENDO
H330H	191	EF-2	173	ENDO-AHU	ISO-ENDO
H335	644	EF-2	584	ENDO-AHU	ISO-ENDO
H339	644	EF-2	584	ENDO-AHU	ISO-ENDO
HS1	240	EF-2	40	H-6	ISO-TB
HS2	250	EF-2	40	H-6	ISO-TB

ROOM NUM	DESIGNED EXHAUST	EXHAUST UNIT	DESIGNED SUPPLY	SUPPLY UNIT	NOTES
H533	240	EF-2	40	H-6	ISO-TB
H534	250	EF-2	40	H-6	ISO-TB
H535	225	EF-2	60	H-6	ISO-TB
H536	240	EF-2	40	H-6	ISO-TB
H537	225	EF-2	40	H-6	ISO-TB
H539	250	EF-2	40	H-6	ISO-TB
H540	250	EF-2	40	H-6	ISO-TB
H542	250	EF-2	40	H-6	ISO-TB
H642	210	EF-2	190	H-6	ISOLATION



Created by UK Facilities Information Services
 Isolation Content: MPPD Personnel
 Geospatial/Requests@uky.edu
 REV: 20150408


Isolation Rooms: 10

UK UNIVERSITY OF KENTUCKY
 UK HealthCare | Negative Isolation Rooms
 Chandler Medical Center (Pavilion H) [0293] Level [05]

ROOM NUM	DESIGNED EXHAUST	EXHAUST UNIT	DESIGNED SUPPLY	SUPPLY UNIT	NOTES
HA015	450	EF-2	245	AHU-1	ICU
HA017	420	EF-2	240	AHU-1	ICU
HA065	438	EF-2	378	AHU-2	A-II PSYCH ROOM
HA066	438	EF-2	378	AHU-2	A-II PSYCH ROOM
HA067	438	EF-2	378	AHU-1	A-II PSYCH ROOM
HA069	285	EF-2	225	AHU-2	A-II PSYCH ROOM
HA070	298	EF-2	238	AHU-1	A-II EXAM ROOM
HA071	276	EF-2	216	AHU-1	A-II EXAM ROOM
HA124	694	ON ROOF BESIDE ROOM	300	AHU-4A	ISOLATION-MICU
HA125	674	ON ROOF BESIDE ROOM	330	AHU-4A	ISOLATION-MICU

ROOM NUM	DESIGNED EXHAUST	EXHAUST UNIT	DESIGNED SUPPLY	SUPPLY UNIT	NOTES
HA225	300	F-21	125	ENDO-AHU	ISOLATION-RECOVERY
HA226	300	F-21	125	ENDO-AHU	ISOLATION-RECOVERY
H330E	191	EF-2	173	ENDO-AHU	ISO-ENDO
H330F	191	EF-2	173	ENDO-AHU	ISO-ENDO
H330G	191	EF-2	173	ENDO-AHU	ISO-ENDO
H330H	191	EF-2	173	ENDO-AHU	ISO-ENDO
H335	644	EF-2	584	ENDO-AHU	ISO-ENDO
H339	644	EF-2	584	ENDO-AHU	ISO-ENDO
HA124	694	ON ROOF BESIDE ROOM	300	AHU-4A	ISOLATION-MICU
HA125	674	ON ROOF BESIDE ROOM	330	AHU-4A	ISOLATION-MICU

ROOM NUM	DESIGNED EXHAUST	EXHAUST UNIT	DESIGNED SUPPLY	SUPPLY UNIT	NOTES
H533	240	EF-2	40	H-6	ISO-TB
H534	250	EF-2	40	H-6	ISO-TB
H535	225	EF-2	60	H-6	ISO-TB
H536	240	EF-2	40	H-6	ISO-TB
H537	225	EF-2	40	H-6	ISO-TB
H539	250	EF-2	40	H-6	ISO-TB
H540	250	EF-2	40	H-6	ISO-TB
H542	250	EF-2	40	H-6	ISO-TB
H642	210	EF-2	190	H-6	ISOLATION

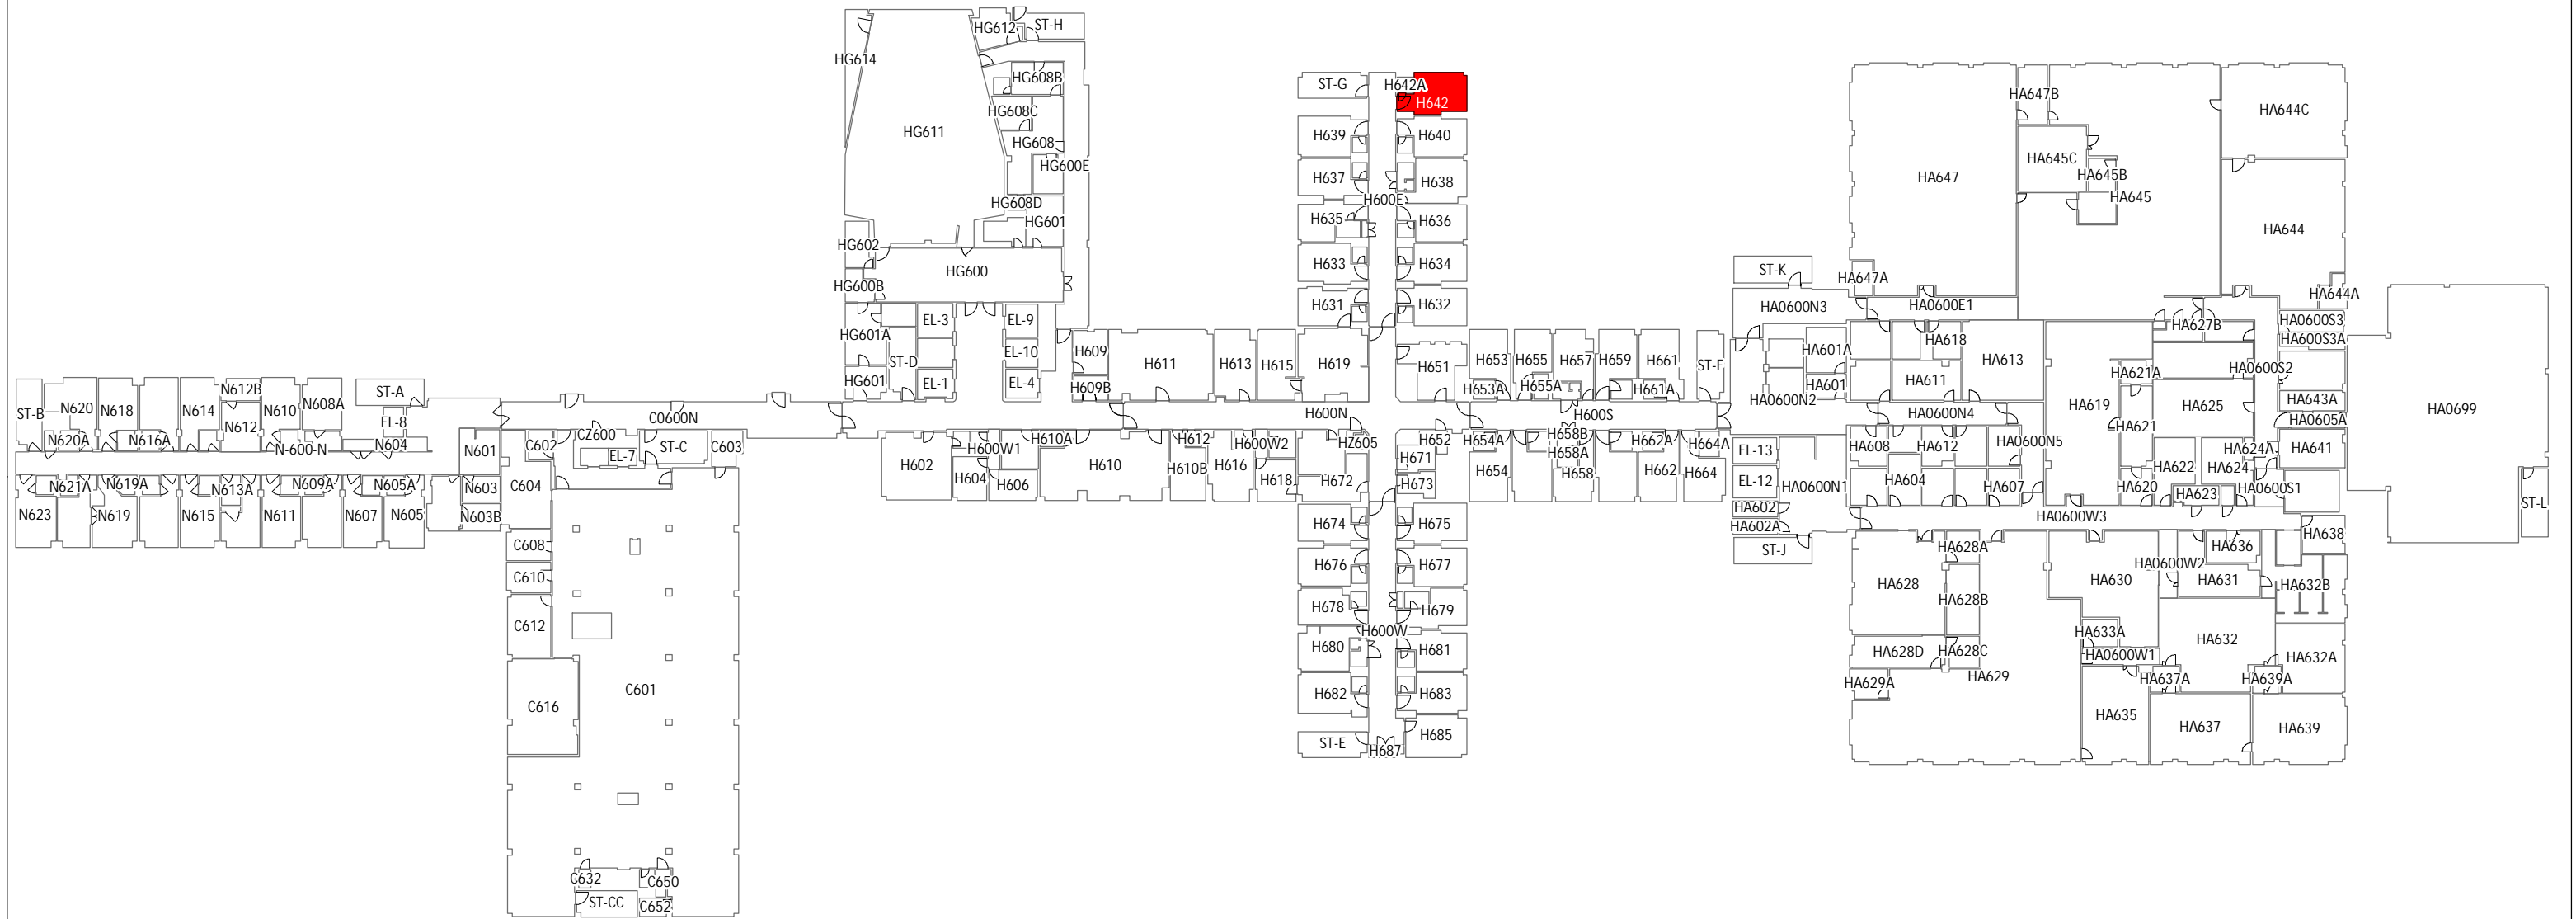

Created by UK Facilities Information Services
 Isolation Content: MPPD Personnel
 Geospatial Requests@uky.edu
 REV: 20150408

Isolation Rooms: 1

UK UNIVERSITY OF KENTUCKY
 UK HealthCare | Negative Isolation Rooms
 Chandler Medical Center (Pavilion H) [0293] Level [06]

ROOM NUM	DESIGNED EXHAUST	EXHAUST UNIT	DESIGNED SUPPLY	SUPPLY UNIT	NOTES
HA015	450	EF-2	245	AHU-1	ICU
HA017	420	EF-2	240	AHU-1	ICU
HA065	438	EF-2	378	AHU-2	A-II PSYCH ROOM
HA066	438	EF-2	378	AHU-2	A-II PSYCH ROOM
HA067	438	EF-2	378	AHU-1	A-II PSYCH ROOM
HA069	285	EF-2	225	AHU-2	A-II PSYCH ROOM
HA070	298	EF-2	238	AHU-1	A-II EXAM ROOM
HA071	276	EF-2	216	AHU-1	A-II EXAM ROOM
HA124	694	ON ROOF BESIDE ROOM	300	AHU-4A	ISOLATION-MICU
HA125	674	ON ROOF BESIDE ROOM	330	AHU-4A	ISOLATION-MICU

ROOM NUM	DESIGNED EXHAUST	EXHAUST UNIT	DESIGNED SUPPLY	SUPPLY UNIT	NOTES
HA225	300	F-21	125	ENDO-AHU	ISOLATION-RECOVERY
HA226	300	F-21	125	ENDO-AHU	ISOLATION-RECOVERY
H330E	191	EF-2	173	ENDO-AHU	ISO-ENDO
H330F	191	EF-2	173	ENDO-AHU	ISO-ENDO
H330G	191	EF-2	173	ENDO-AHU	ISO-ENDO
H330H	191	EF-2	173	ENDO-AHU	ISO-ENDO
H335	644	EF-2	584	ENDO-AHU	ISO-ENDO
H339	644	EF-2	584	ENDO-AHU	ISO-ENDO
H531	240	EF-2	40	H-6	ISO-TB
H532	250	EF-2	40	H-6	ISO-TB

ROOM NUM	DESIGNED EXHAUST	EXHAUST UNIT	DESIGNED SUPPLY	SUPPLY UNIT	NOTES
H533	240	EF-2	40	H-6	ISO-TB
H534	250	EF-2	40	H-6	ISO-TB
H535	225	EF-2	60	H-6	ISO-TB
H536	240	EF-2	40	H-6	ISO-TB
H537	225	EF-2	40	H-6	ISO-TB
H539	250	EF-2	40	H-6	ISO-TB
H540	250	EF-2	40	H-6	ISO-TB
H542	250	EF-2	40	H-6	ISO-TB
H642	210	EF-2	190	H-6	ISOLATION