


# 236000D01 CENTRAL COOLING EQUIPMENT Secondary Pumping

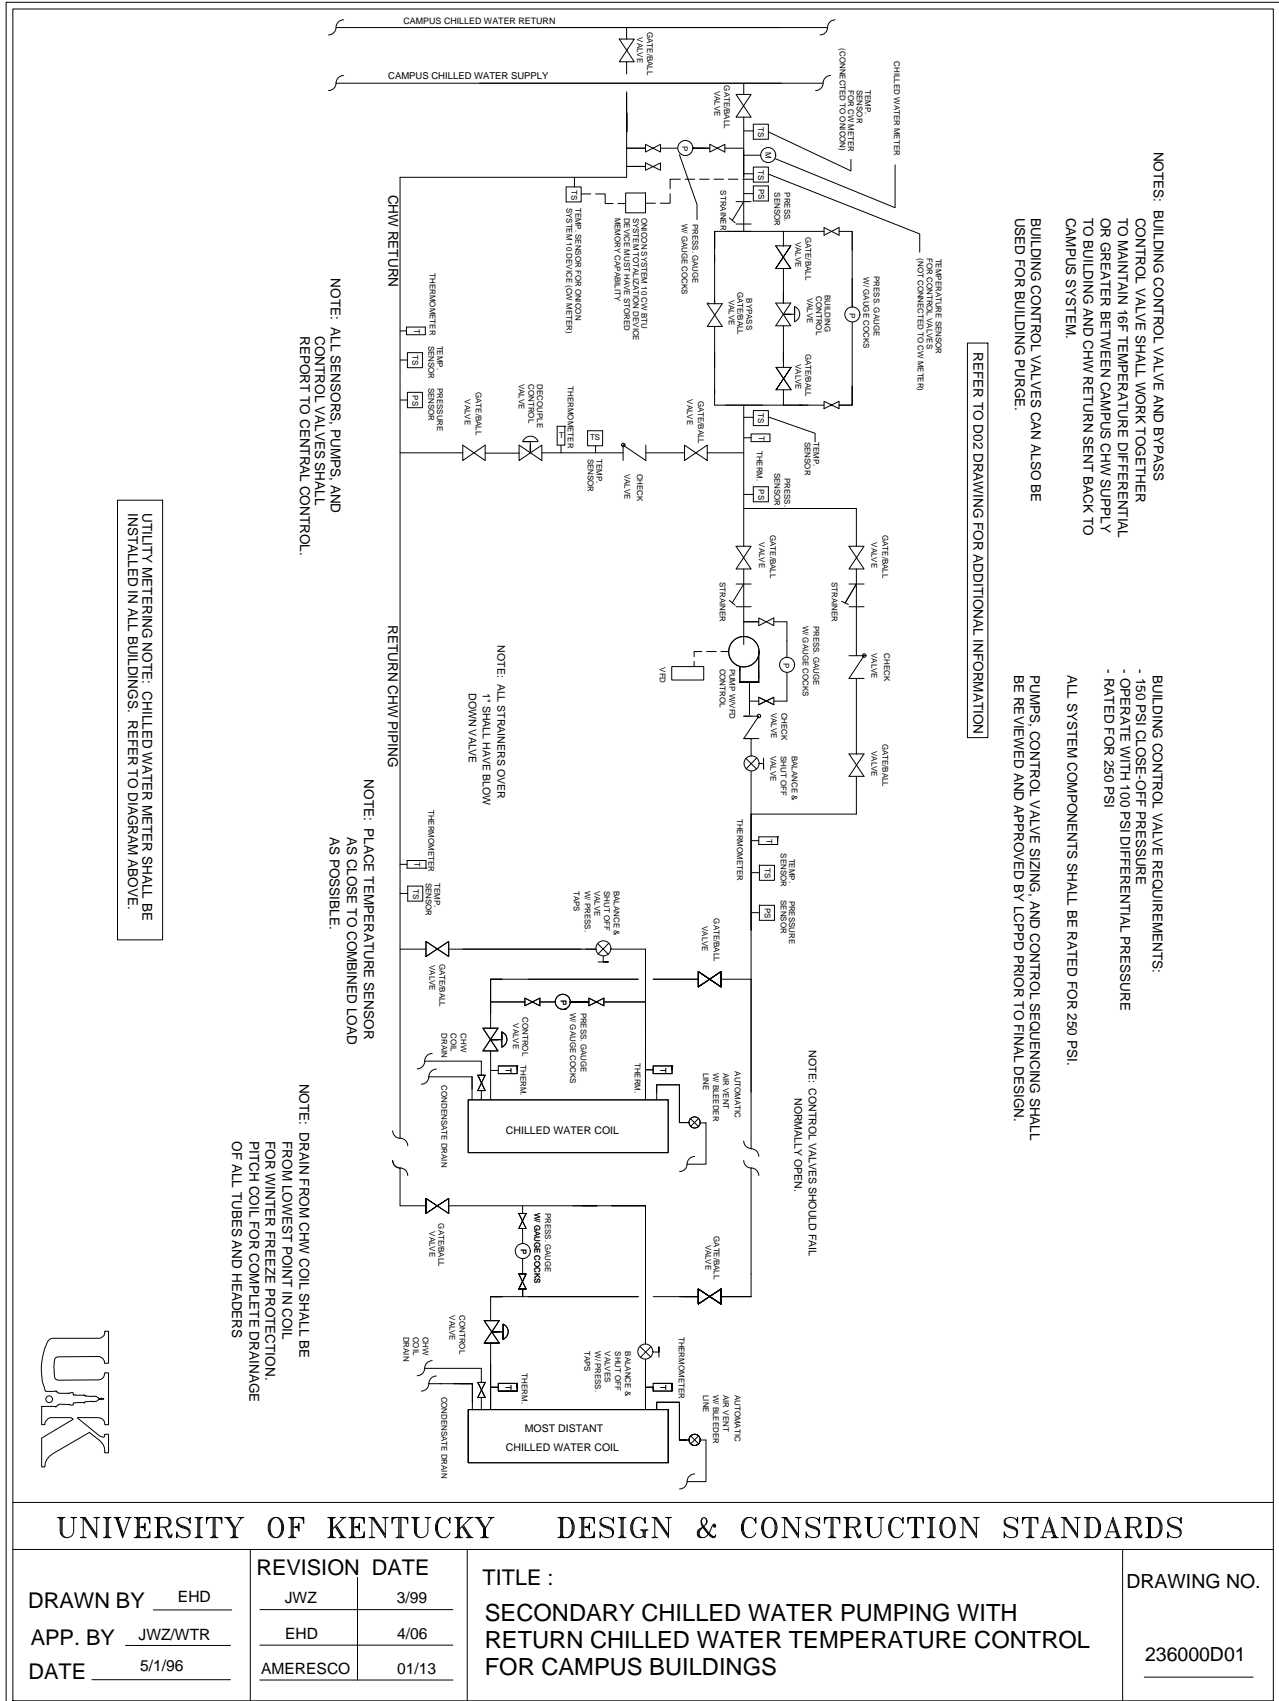

## UNIVERSITY OF KENTUCKY DESIGN & CONSTRUCTION STANDARDS

DRAWN BY <u>EHD</u> APP. BY <u>JWZ/WTR</u> DATE <u>5/1/96</u>	REVISION	DATE	TITLE : <b>SECONDARY CHILLED WATER PUMPING WITH RETURN CHILLED WATER TEMPERATURE CONTROL FOR CAMPUS BUILDINGS</b>	DRAWING NO. <u>236000D01</u>
	JWZ	3/99		
	EHD	4/06		
	AMERESCO	01/13		