


# 236000D03 CENTRAL COOLING EQUIPMENT

## Chilled Water Meter Detail

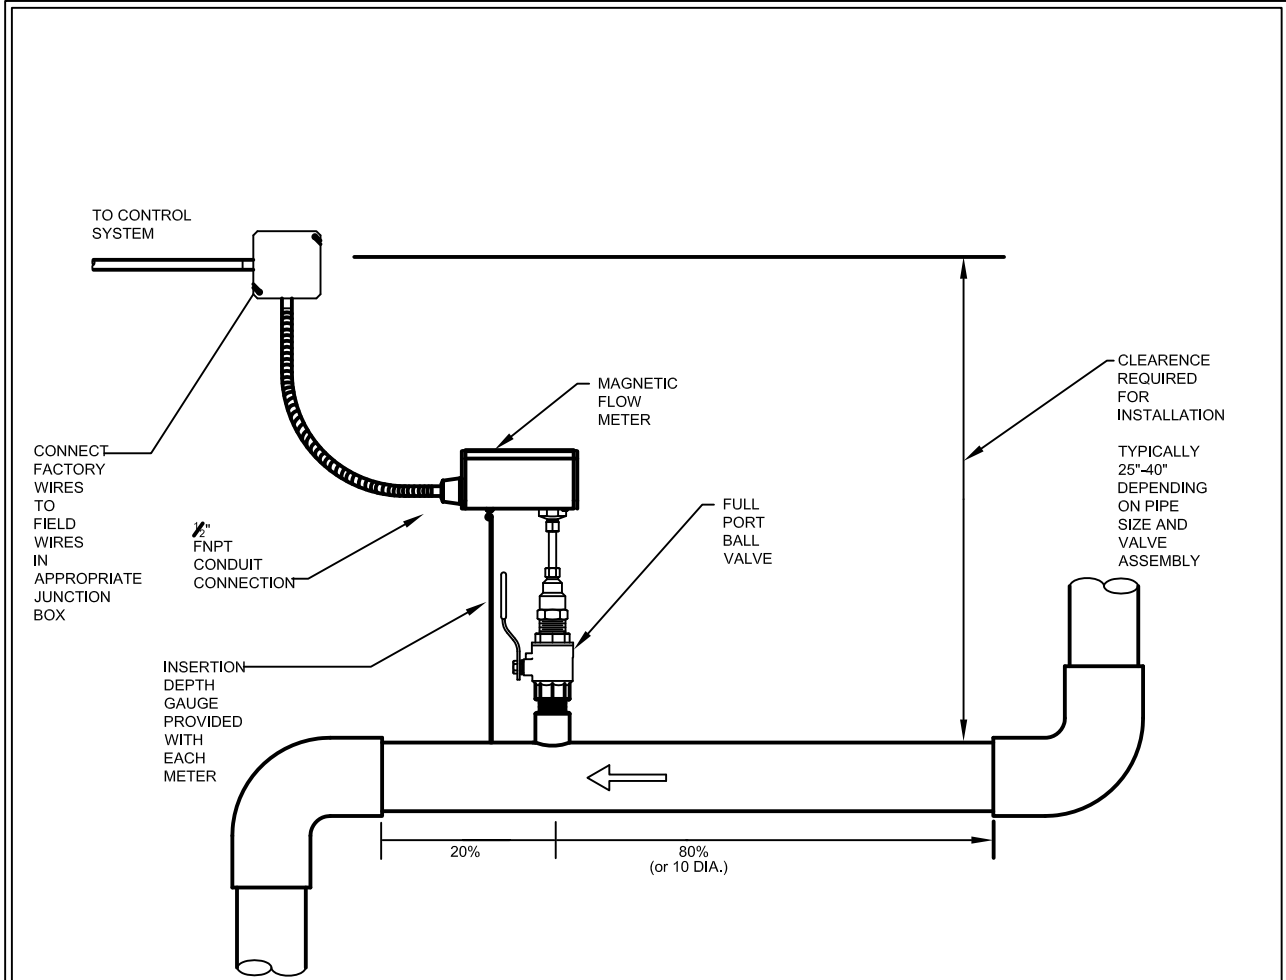

### TYPICAL CHILLED WATER METER DETAIL

NO SCALE

#### NOTES:

1. ALL BUILDINGS SHALL BE METERED. THE INFORMATION SHALL BE READ LOCALLY AND REMOTELY WITH THE BUILDING AUTOMATION SYSTEM (BAS)
2. METER SHALL BE INSTALLED BEFORE THE BUILDING DECOUPLE BYPASS
3. REFER TO 236000D01 BUILDING CHILLED WATER DETAIL FOR ENTIRE BUILDING DETAIL

UK

UNIVERSITY OF KENTUCKY

DESIGN & CONSTRUCTION

STAN

DRAWN BY AMERESCO APP. BY <u>JWZ</u> DATE <u>01/13</u>	REVISION DATE BMR   07/2019 <hr/> <hr/>	TITLE : CHILLED WATER METER INSTALLATION	DRAWING NO.  236000D03
--	---	---	------------------------------